



JUMO dTRANS CR 02

Transmitter/controller for conductivity, TDS, resistance, standard signals and temperature

Brief description

The JUMO dTRANS CR 02 is a compact, modular instrument. It is highly flexible (for example 3 slots for optional boards) and capable of performing a wide range of tasks. The main input of the JUMO dTRANS CR 02 is used for sensors for measuring electrolytic conductivity, specific resistance, or the TDS value. Both conductive two-electrode and four-electrode cells can be connected to the instrument. The second analog input (compensation input) is designed for resistance thermometers Pt100 and Pt1000, NTC/PTC or standard signals 0(4) - 20 mA or 0 - 10 V. The two binary inputs can be used either as initiators for actions (e.g. HOLD, keyboard inhibit) or when connecting pulse generators (for example impeller sensors) for flow-rate measurement. The high-contrast graphic display allows for several options including display of input signal with numbers or as bar graph. Parameters are displayed in plain text for easily comprehensible and reliable operation.

The JUMO dTRANS CR 02 can be used as a two-point or three-point controller, a three-point modulating controller, or as a continuous controller. All controller outputs can be configured to P, PI, PD or PID action. The software for the controllers includes parameter set selection, a math module and more.

A setup program is available for convenient configuration via PC. The instrument can be integrated into a data network by means of an RS422/485 or Profibus DP interface. Screw terminals on the back are used for the electrical connection.

Some applications:

- Industrial and process water.
- Drinking and well water.
- Pure, ultra-pure and pharmaceutical water (e.g. as per USP, Ph. Eur., WFI).
- Cleaning processes in pharmaceutical applications (four-electrode cells in conjunction with measuring range selection).

Meets
requirements of
USP<645>




JUMO dTRANS CR 02
Type 202552



JUMO dTRANS CR 02
in surface-mounted enclosure

Block diagram

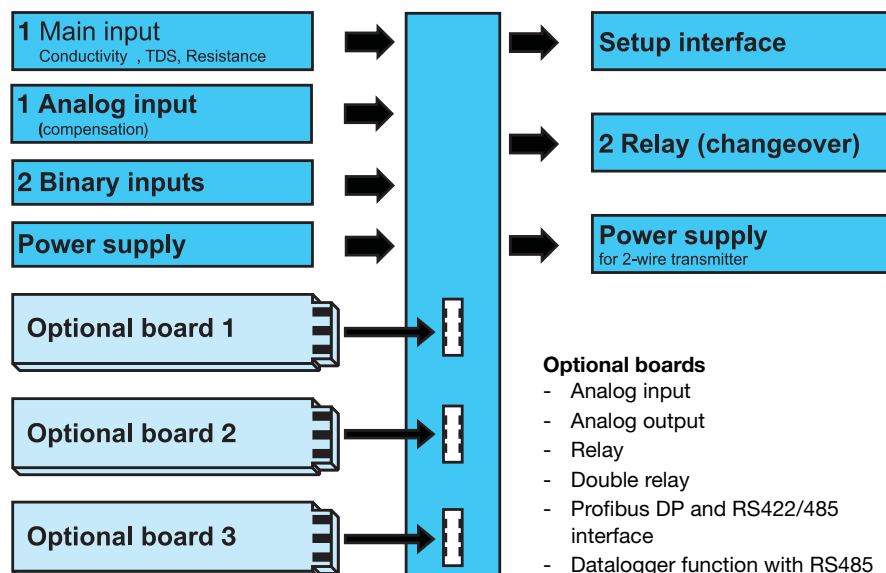


Special features

- A choice of display visualizations: large numbers, bar graph or tendency (trend) display
- Integrated calibration routines: Cell constant, temperature coefficient
- Math and logic module
- Calibration logbook
- Integrated washing timer to control the cleaning equipment
- 13 operator languages integrated; see order details
- Setup program provides: convenient programming, system documentation
- RS422/485 interface (optional)
- Profibus-DP interface (optional)
- Flush-mounted instrument - just 96 mm x 48 mm x 95 mm
- Electrode monitoring can be activated
- Flow-rate measurement



Boards

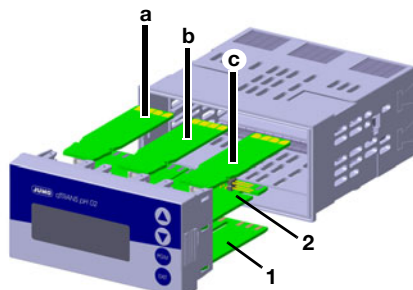

(1)	PSU board
(2)	Main board
(a)	Optional board 1
(b)	Optional board 2
(c)	Optional board 3

PSU board (1)

This board is always fitted in the instrument and no variations are possible.

The board includes the following items:

- The power supply for the JUMO dTRANS CR 02.
- The power supply for external 2-wire transmitters.
- 2 relays with changeover contacts.

Main board (2)

This board can **not** be changed subsequently!
The main board (CR) has:

- The main input for connecting a two- or four-electrode conductivity cell.
- The secondary input for connecting a temperature sensor Pt100, Pt1000, a resistance transmitter or a standard signal 0(4) - 20 mA or 0 - 10 V.
- 2 binary inputs.
- The setup interface (for PC interface adapter).

Optional board (1), (2) or (3)

These boards are combinable and can be ordered in the following versions:

- 1 analog input
- 1 continuous output
- 1 relay (changeover)
- 2 relays (NO with common pin)
- 1 Triac (1 A)
- 1 Foto-MOS relay (0.2 A)

The following boards can **only** be placed in slot 3, either:

- Modbus / Jbus
- Profibus
- Datalogger

Functional description

The instrument is a modularly designed indicator/controller for use in both simple and demanding control tasks. It can be integrated into the PLC via interfaces

To make programming and operation easy, all parameters are clearly assigned to levels and displayed in plain text. Operation is protected by a code word. Operation can be adapted on an individual basis because parameters can be generally enabled or assigned to the protected area.


A setup program for the PC is available as a more convenient configuration option, rather than using the instrument keypad.

User data



Up to 8 parameters that are frequently changed by the user can be combined in the user level under "User data" (via setup program only).

Displays and controls

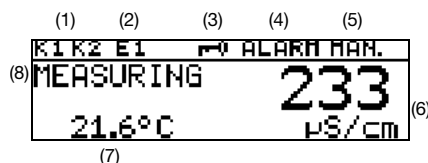


(1)	Binary outputs (relays) Output active if symbol is visible.
(2)	Binary input Input closed if symbol is visible.
(3)	Keyboard inhibit Keys locked if symbol is visible.
(4)	Alarm message ALARM (flashing): Broken sensor or overrange, etc. AL R1: Controller monitoring alarm from controller channel 1. AL R2: Controller monitoring alarm from controller channel 2. CALIB: Calibration mode active. CALIB (flashing): Calibration timer elapsed.
(5)	Output mode MAN.: Manual mode active. HOLD: Hold mode active.
(6)	Top display Measured value and unit of the variable set by parameter "Top display".
(7)	Bottom display Measured value and unit of the variable set by parameter "Bottom display".
(8)	Operating mode MEASURING: Standard measuring mode is active.

Display modes

The following display modes are available:

Normal display




In this display method the measurements appear in numbers, as usual.

Large display



This method uses the complete display height.

Tendency display




In this display a symbol is added to the numerical value to indicate the direction and speed of change for the measurement value. This can be very useful for optimizing the controller, for example.



From left to right:

Fast, medium and slow rise, steady, slow, medium and fast fall.

Bar graph



In this display mode, it only takes a glance to ascertain the range for the current measurement.


Any scale can be used for the bar graph.

Tendency curve (data monitor)



The ring buffer contains about 100 measuring points. The sampling and storage rates can be adjusted.

Flow rate quantity



If an input has been configured for flow-rate measurement, this display can be accessed.

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us



Function modes of the main board

Conductivity measurement

The measurement can be conducted either with standard two-electrode or with four-electrodes cells.

Two-electrode cells can be connected in the usual grid of cell constants ($K=0.01$; 0.1 ; 1.0 ; 3.0 and 10.0). The "relative cell constant" can be adjusted over wide ranges, which makes it possible to connect sensors with different cell constants as well (for example $K=0.2$).

Values $K=0.5$ and 1.0 are predefined for four-electrode cells. In this case as well, the device can be adjusted to sensors with different cell constants (for example $K=0.4$).

The instrument is able to perform an automatic temperature compensation.

Resistance

The instrument can be switched to resistance measurement for applications in which display of the resistance value is preferred over the conductivity value.

TDS

Display/control with the unit ppm.

The specific TDS factor can also be entered in this mode.

Temperature compensation

The conductivity or resistance of aqueous solutions often depends greatly on the temperature. The instrument provides the following procedures for temperature compensation, depending on the display size:

- Off (e.g. USP)
- Linear
- ASTM
- Natural waters (EN 27888/ISO 7888)

Analog input for main board

$0(4) - 20 \text{ mA}$; $0 - 10 \text{ V}$ and $\text{Pt}100 / \text{Pt}1000 / \text{NTC} / \text{PTC}$ (max. $30 \text{ k}\Omega$) / cust. specs.

Typical application: Compensation input for temperature compensation of the main measurement variable.

Function modes of the input options, "Multi-channel mode"

If analog inputs have been fitted (optional board), the device will have multi-channel functions. The following signal types can be processed:

- $0(4) - 20 \text{ mA}$
- $0 - 10 \text{ V}$
- $\text{Pt}100 / \text{Pt}1000$

Sensors that return one of the output signals listed above can be connected to the instrument for the following measurement variables, for example:

- free chlorine, chlorine dioxide, ozone, hydrogen peroxide and peracetic acid as per data sheet 20.2630.
- pH value or redox potential as per data sheet 20.2701.
- Liquid level measurements.
- Flow rate measurements.
- etc.

The instrument provides the following calibration options in this function mode:

- Zero point
- Limit value
- Zero point and limit value
- Cell constant
- Temperature coefficient

This allows optimum adaptation of the instrument to the sensor.

Linear scaling

Select this mode when the input signal will be displayed linearly.

One of the following units is used for display or control:

- $\mu\text{S/cm}$
- mS/cm
- %
- mV
- pH
- ppm
- Cust. specs. (5 characters)

Electrolytic conductivity

$\mu\text{S/cm}$ or mS/cm are the units used for display and control.

Specific resistance (ultra-pure water)

Display/control with the unit $\text{k}\Omega \times \text{cm}$ or $\text{M}\Omega \times \text{cm}$.

TDS

Display/control with the unit ppm.

The specific TDS factor can also be entered in this mode.

Concentration

In this mode, the concentration of a liquid can be determined from its uncompensated conductivity.

% or "Cust. specs." are the units used for display and control.

Concentration measurement:

Caustic solution

NaOH	0 - 15% by wt.	0 - 90°C
NaOH	25 - 50% by wt.	0 - 90°C

Nitric acid

HNO_3	0 - 25% by wt.	0 - 80°C
HNO_3	36 - 82% by wt.	-20 - 80°C

Sulfuric acid

H_2SO_4	0 - 28% by wt.	0 - 100°C
H_2SO_4	36 - 85% by wt.	0 - 115°C
H_2SO_4	92 - 99% by wt.	0 - 115°C

Hydrochloric acid

HCl	0 - 18% by wt.	0 - 65°C
Hal	22 - 44% by wt.	-20 - 65°C

Cust. specs. with table

Non-linear correlations between the input and output variable can be processed in this mode. Typical applications include measuring the level of liquid in horizontal, cylindrical containers or simply measuring the concentration.

The input values are processed in a table (max. 20 value pairs). Values can only be entered in the table using the optional setup program.

The units used for display and control are:

- $\mu\text{S/cm}$
- mS/cm
- Cust. specs. (5 characters)
- Use the offset parameter to adjust the display.

Calibration

Calibration logbook

The last five successful calibrations can be accessed from the calibration logbook. This makes it possible to evaluate the aging of the connected sensor.

The logbook can be deleted if necessary (useful when changing the sensor).

If a datalogger has been fitted (optional board), additional information such as the date and time are documented.

Calibration timer

The calibration timer indicates (on request) a required routine calibration. The calibration timer is activated by entering the number of days that must expire before there is a scheduled re-calibration (specified by the system or the operator).



Additional functions of the JUMO dTRANS CR 02

Min/max value memory

This storage records the minimum and maximum input quantities that have occurred. This information can be used, for example, to assess whether the design of the connected sensor is suitable for the values that actually occur.

Binary input

The following functions can be accessed through the binary input:

- Key lock activation
When this function is activated, operation is no longer possible via the keypad.
- "HOLD" mode activation
When this function is activated, the outputs (analog and relay) adopt the states previously defined.
- Alarm suppression (controller alarm only)
This function is used to temporarily deactivate alarm generation by means of the appropriately configured relay.
- Flow-rate measurement (counting input)
Instantaneous value
Partial quantity
Total quantity

Bridging the corresponding connection terminals with a floating contact (for example a relay) activates a predefined function.

Deposit detection

Deposit detection can be activated for four-electrode cells.

It may happen during normal operation that a coating forms on the electrodes. Because of this, the conductivity that is displayed is lower than the actual conductivity. When the "Deposit detection" function is activated, cell maintenance is required.

Auto range

In some processes it is advantageous to have two measurement ranges available, for example in rinsing and regeneration processes.

Normally in these processes a low conductivity must be recorded exactly. In the case of rinsing / regeneration, however, the conductivity is significantly higher, which would result in measurement overrange (error). The Autorange function can be used to define two measurement ranges between which the instrument switches in a defined manner.

Wash timer

A software function can be used to trigger cyclically recurring actions by controlling a relay.

Control functions

Functions can be assigned to the relays. The functions can be configured in turn by parameters P, PI, PD and PID structures can be freely programmed as control functions.

Relay outputs

Two relay changeover contacts are available for the main measurement variable and/or the temperature.

The following functions can be programmed:

- Switching direction (min/max)
- Limit controller (on-delay/delayed release, hysteresis)
- Pulse length output (see control functions)
- Pulse frequency output (see control functions)
- Modulating function (see control functions)
- Pulse functions
With this function, the output briefly switches on when the switching point is reached and then switches off again
- Wash timer elapsed
- Alarm
- Sensor/range error
- Behavior in the event of an alarm, underrange or overrange measurement, calibration and "HOLD"

Flow-rate measurement

Flow rate transmitters can be connected directly to the binary inputs. One input is available for "slow speed" (up to about 300 Hz) and one for "high speed" (up to about 10 kHz). The current flow rate, partial quantity and total quantity can be displayed in different units (l/s, l/min, l/h, m³/min, m³/h, GAL(US)/s, GAL(US)/min, GAL(US)/h, or l, m³, GAL(US)).

Datalogger


Up to 43,500 data sets can be stored in the datalogger (ring buffer). Depending on the resolution, that corresponds to a storage time ranging from about 10 hours to 150 days.

Data can be read by means of the setup program and then further processed with an "Office" product.


The datalogger makes it possible to record and document processes and supports analysis of the same processes.

Contact functions


Max. limit function

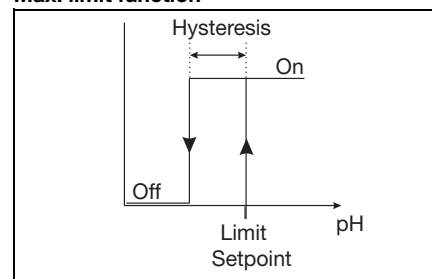


Min. limit function

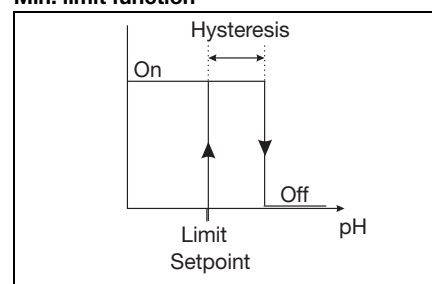

Alarm window 1

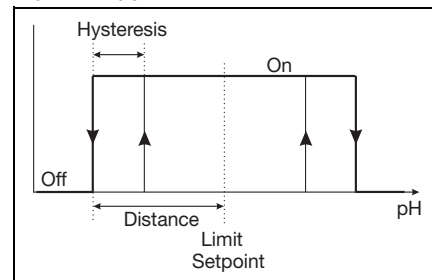



Alarm window 2

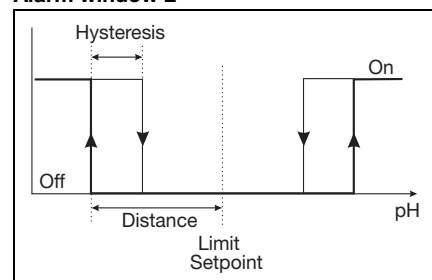

Pulse contact

Triggering condition longer than pulse duration

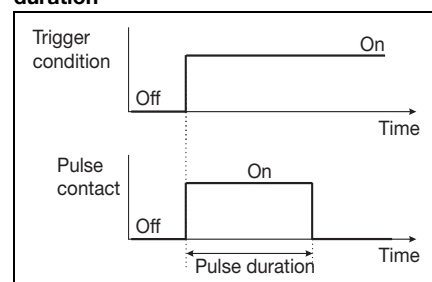


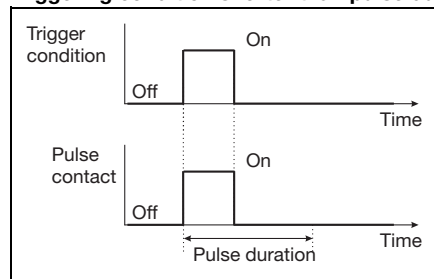
**Pulse contact****Triggering condition shorter than pulse duration****Math and logic module**

The math module makes it possible to integrate measurement value of the analog inputs into a mathematical formula so that the calculated process variable can be displayed. The logic module can be used, for example, to link binary inputs and limit comparators with each other logically.


Up to two math or logic formulas can be entered with the optional setup program and the results of calculations can be displayed or exported via outputs (via PC setup software only).

Setup PC program (accessory)

The setup PC program is available in German, English and French for configuring the instrument. You can use it to create and edit sets of data and transfer them to the instrument, as well as read them out from it. The data can be stored and printed.

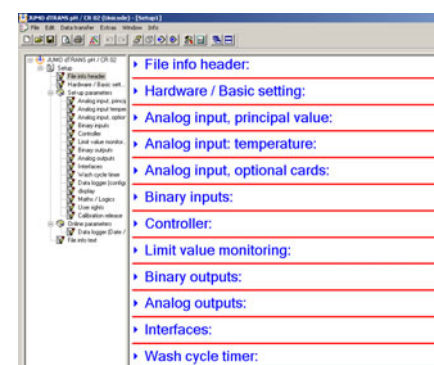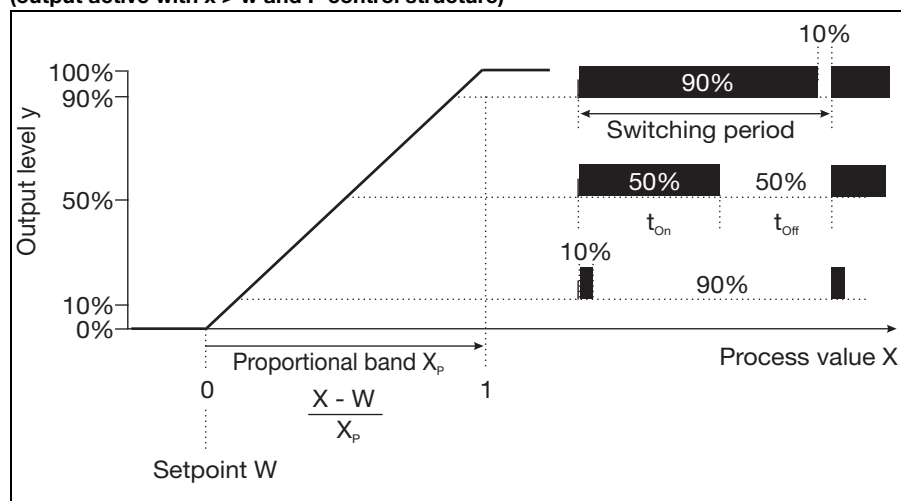**Pulse width controller****(output active with $x > w$ and P control structure)**

If actual value x exceeds setpoint w , the P controller will control in proportion to the control deviation. When the proportional range is exceeded, the controller operates with an output level of 100% (100% clock ratio).

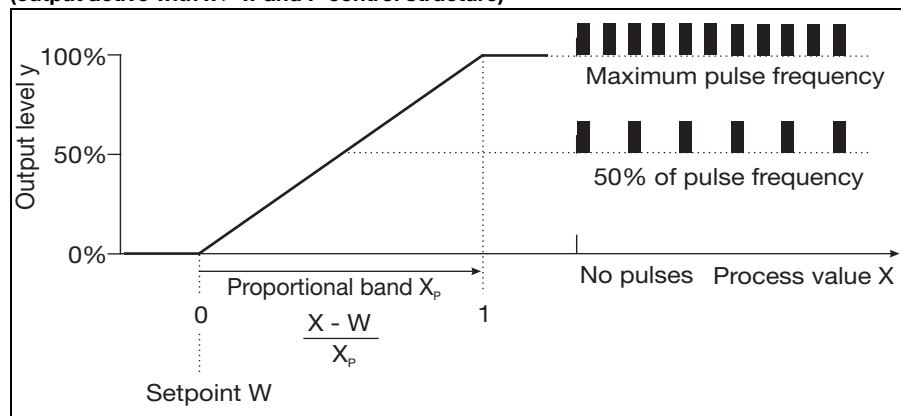Pulse frequency controller**(output active with $x > w$ and P control structure)**

If actual value x exceeds setpoint w , the P controller will control in proportion to the control deviation. When the proportional range is exceeded, the controller operates with an output level of 100% (maximum switching frequency).

Setup interface

The setup interface is integrated into the JUMO dTRANS CR 02 by default. You can use it, together with the setup program (accessory) and a setup interface (accessory), to configure the instrument.

RS232/RS485 interface

The serial interface is used for communication with higher-level systems when the Modbus/Jbus protocol is used.

PROFIBUS-DP

The JUMO dTRANS CR 02 can be integrated into a fieldbus system according to the PROFIBUS-DP standard via the PROFIBUS-DP interface. This PROFIBUS version is especially designed for communication between automation systems and distributed peripheral devices at the field level and is optimized for speed.

Data is transferred serially based on the RS485 standard.

Using the project design tool that is included in the delivery (GSD generator; GSD = device master file), a standardized GSD file is created by selecting characteristic device features of the JUMO dTRANS CR 02. This file is used to integrate the controller into the fieldbus system.

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us



Measurement ranges / cell constants

This modern instrument features a much higher dynamic range on the input side than conductivity cells are able to control physically or chemically. The measurement range of the instrument must therefore be coordinated with the operating range of the cell.

Sample measuring ranges for combinations with two-electrode cells

Cell constant (K)	Recommended/practical measurement scope (depending on the conductivity cell)
0.01 1/cm	0.05 $\mu\text{S}/\text{cm}$ - 20 $\mu\text{S}/\text{cm}$
0.1 1/cm	1 $\mu\text{S}/\text{cm}$ - 1000 $\mu\text{S}/\text{cm}$
1.0 1/cm	0.01 mS/cm - 100 mS/cm
3.0 1/cm	0.1 mS/cm - 30 mS/cm
10.0 1/cm	0.1 mS/cm - 200 mS/cm

Example

To conduct a measurement in the range from 10 $\mu\text{S}/\text{cm}$ to 500 $\mu\text{S}/\text{cm}$, select a conductivity cell with a cell constant $K = 0.1$ 1/cm. Configure the unit $\mu\text{S}/\text{cm}$ on the instrument without places after the decimal.

Combination with four-electrode cells and two-electrode cells with cell constant differing from the grid above

This case requires a more in-depth use of the instrument technology. Both the uncompensated and the temperature compensated measurement scope must be considered.

The uncompensated measurement scope of the instrument may be calculated according to the following formula:

Measurement scope = $0.1 \mu\text{S}/\text{cm} \times \text{cell constant (K)}$ to $2500 \text{ mS} \times \text{cell constant (K)}$.

After consideration of the temperature compensation range, approximately the following compensated measurement scope remains:

Measurement scope = $0.1 \mu\text{S}/\text{cm} \times \text{cell constant (K)}$ to $1250 \text{ mS} \times \text{cell constant (K)}$.

Cell constant (K)	Measurement scope based on instrument (temperature-compensated)
0.01	0.001 $\mu\text{S}/\text{cm}$ - 1.25 mS/cm
0.1	0.01 $\mu\text{S}/\text{cm}$ - 12.5 mS/cm
1.0	0.1 $\mu\text{S}/\text{cm}$ - 125 mS/cm
3.0	0.3 $\mu\text{S}/\text{cm}$ - 375 mS/cm
10.0	0.1 mS/cm - 1250 mS/cm

It may be assumed that the measurement scope of the instrument is always greater than the recommended or practically usable range of the conductivity cell that is used.

The smaller range (instrument or conductivity cell) determines the maximum usable range.

Example

What measurement scope can the instrument cover with a specified cell constant?

The specified cell constant is $K=0.4$

The measurement scope of the instrument = $0.1 \mu\text{S}/\text{cm} \times 0.4$ 1/cm to $1250 \text{ mS}/\text{cm} \times 0.4$ 1/cm $\rightarrow$ 0.04 $\mu\text{S}/\text{cm}$ - 500 mS/cm

JUMO GmbH & Co. KG
 Delivery address: Mackenrodtstraße 14,
 36039 Fulda, Germany
 Postal address: 36035 Fulda, Germany
 Phone: +49 661 6003-0
 Fax: +49 661 6003-607
 E-mail: mail@jumo.net
 Internet: www.jumo.net

JUMO Instrument Co. Ltd.
 JUMO House
 Temple Bank, Riverway
 Harlow - Essex CM20 2DY, UK
 Phone: +44 1279 63 55 33
 Fax: +44 1279 63 52 62
 E-mail: sales@jumo.co.uk
 Internet: www.jumo.co.uk

JUMO Process Control, Inc.
 8 Technology Boulevard
 Canastota, NY 13032, USA
 Phone: 315-697-JUMO
 1-800-554-JUMO
 Fax: 315-697-5867
 E-mail: info@jumo.us
 Internet: www.jumo.us



Technical data

Inputs (main board)

Main input	Measuring range/control range	Accuracy	Effect of temperature
$\mu\text{S/cm}$	0.000 - 9.999 00.00 - 99.99 000.0 - 999.9 0000 - 9999	$\leq 0.6\%$ of range + $0.3 \mu\text{S} \times \text{cell constant (K)}$	0.2%/10K
mS/cm	0.000 - 9.999 00.00 - 99.99 000.0 - 999.9 0000 - 9999	$\leq 0.6\%$ of range + $0.3 \mu\text{S} \times \text{cell constant (K)}$	0.2%/10K
$\text{k}\Omega \times \text{cm}$	0.000 - 9.999 00.00 - 99.99 000.0 - 999.9 0000 - 9999	$\leq 0.6\%$ of range + $0.3 \mu\text{S} \times \text{cell constant (K)}$	0.2%/10K
$\text{M}\Omega \times \text{cm}$	0.000 - 9.999 00.00 - 99.99 000.0 - 999.9 0000 - 9999	$\leq 0.6\%$ of range + $0.3 \mu\text{S} \times \text{cell constant (K)}$	0.2%/10K
Secondary input			
Temperature Pt100/1000	-50-250°C ¹	$\leq 0.25\%$ of range	0.2%/10K
Temperature NTC/PTC	0.1 - 30 k Ω Entry via table with 20 value pairs	$\leq 1.5\%$ of range	0.2%/10K
Standard signal	0(4) - 20 mA or 0 - 10 V	0.25% of range	0.2%/10K
Resistance transmitter	Minimum: 100 Ω Maximum: 3 k Ω	+/- 5 Ω	0.1%/10K

¹ Selectable in °F.

Resistance thermometer inputs (optional board)

Designation	Connection	Measuring range	Measuring accuracy		Effect of ambient temperature
			3-wire/4-wire	2-wire	
Pt100 DIN EN 60751 (factory-set)	2-wire/3-wire 4-wire	-200 - +850°C	$\leq 0.05\%$	$\leq 0.4\%$	50 ppm/K
Pt1000 DIN EN 60751 (factory-set)	2-wire/3-wire 4-wire	-200 - +850°C	$\leq 0.1\%$	$\leq 0.2\%$	50 ppm/K
Sensor lead resistance	Maximum 30 Ω per line with three- and four-wire circuit				
Measurement current	approx. 250 μA				
Lead compensation	Not required for three- and four-wire circuit. With a 2-wire circuit, lead resistance can be compensated in the software by correcting the process value.				

Standard signals inputs (optional board)

Designation	Measuring range	Measuring accuracy	Effect of ambient temperature
Voltage	0(2) - 10 V 0 - 1 V Input resistance _E > 100 k Ω	$\leq 0.05\%$	100 ppm/K
Electrical current	0(4) - 20 mA, voltage drop $\leq 1.5 \text{ V}$	$\leq 0.05\%$	100 ppm/K
Resistance transmitter	Minimum: 100 Ω Maximum: 4 k Ω	+/- 4 Ω	100 ppm/K

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

**Temperature compensation**

Type of compensation	Range ¹
Linear 0 - 8%/K	-10 - 160°C
ASTM D1125 - 95 (ultra-pure water)	0 - 100°C
Natural waters (ISO 7888)	0 - 36°C
Reference temperature	
Adjustable from 15 - 30°C; preset to 25°C (default)	

¹ Note the sensor operating temperature range!

Measuring circuit monitoring

Inputs	Underrange/ overrange	Short circuit	Broken lead
Conductivity	Yes	Depends on measuring range	Depends on measuring range
Temperature	Yes	Yes	Yes
Voltage 2 - 10 V	Yes	Yes	Yes
2 - 10 V	Yes	No	No
Current 4 - 20 mA	Yes	Yes	Yes
0 - 20 mA	Yes	No	No
Resistance transmitter	No	No	Yes

Two-electrode systems

Cell constant [1/cm]	Setting range of the relative cell constant	Resulting usable range [1/cm]
0.01	20 - 500%	0.002 - 0.05
0.1		0.02 - 0.5
1.0		0.2 - 5
3.0		0.6 - 15
10.0		2.0 - 50

Four-electrode systems

Cell constant [1/cm]	Setting range of the relative cell constant	Resulting usable range [1/cm]
0.5	20 - 150%	0.1 - 0.75
1.0		0.2 - 1.5

Binary input

Activation	Floating contact is open: function is not active Floating contact is closed: function is active
Function	Key lock, manual mode, HOLD, HOLD inverse, alarm suppression, freeze measured value, level lock, reset partial quantity, reset total quantity, parameter set switchover

Controller

Controller type	Limit comparators, limit controllers, pulse length controllers, pulse frequency controllers, modulating controllers, continuous controllers
Controller structure	P / PI / PD / PID

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

**Outputs**

Relay (changeover) - Contact rating - Contact service life	PSU board	5 A at 240 VAC resistive load 350,000 operations at nominal load/750,000 operations at 1 A
Supply voltage for 2-wire transmitter	PSU board	Electrically isolated, non-controlled DC 17 V at 20 mA, open-circuit voltage approx. DC 25 V
Power supply for inductive proximity switch	Optional board	DC 12 V; 10 mA
Relay (changeover) - Contact rating - Contact service life	Optional board	8 A at AC 240 V resistive load 100,000 operations at nominal load/350,000 operations at 3 A
Relay SPST (normally open) - Contact rating - Contact service life	Optional board	3 A at 240 VAC resistive load 350,000 operations at nominal load/900,000 operations at 1 A
Semiconductor relay - Contact rating - Protective circuit	Optional board	1 A at 240 V Varistor
Semiconductor switch (photo MOS)	Optional board	$U \leq 50 \text{ V AC/DC}$ $I \leq 200 \text{ mA}$
Voltage - Output signals - Load resistance - Accuracy	Optional board	0 - 10 V / 2 - 10 V $R_{\text{load}} \geq 500 \Omega$ $\leq 0.5\%$
Electrical current - Output signals - Load resistance - Accuracy	Optional board	0 - 20 mA / 4 - 20 mA $R_{\text{load}} \leq 500 \Omega$ $\leq 0.5\%$

Display

Type	LC graphic display, blue with background lighting, 122 x 32 pixels
------	--

Electrical data

Supply voltage (switch-mode PSU)	AC 110 - 240 V -15/+10%; 48 - 63 Hz or AC/DC 20-30 V; 48 - 63 Hz
Electrical safety	to DIN EN 61010, Part 1 overvoltage category II, pollution degree 2
Power consumption	Max. 13 VA
Data backup	EEPROM
Electrical connection	On the back via screw terminals, conductor cross-section up to max. 2.5 mm ²
Electromagnetic Compatibility (EMC) - Interference emission - Immunity to interference	DIN EN 61326-1 Class A to industrial requirements

Enclosure

Enclosure type	Plastic enclosure for panel mounting to DIN IEC 61554
Depth behind panel	90 mm
Ambient temperature Storage temperature	-5 - +55°C -30 - +70°C
Climatic rating	Rel. humidity $\leq 90\%$ annual mean, no condensation
Operating position	Horizontal
Enclosure protection - In the panel enclosure - In the surface-mounted enclosure	to DIN EN 60529 front IP65, rear IP20 IP65
Weight (fully fitted)	approx. 380 g

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

**Interface**

Modbus	
Interface type	RS422/RS485
Protocol	Modbus, Modbus Integer
Baud rate	9600, 19200, 38400
Device address	0 - 255
Max. number of nodes	32
PROFIBUS-DP	
Device address	0 - 255

Approvals/marks of conformity

Mark of conformity	Testing laboratory	Certificates/certification numbers	Test basis	valid for
c UL us	Underwriters Laboratories	Registered	UL 61010-1 CAN/CSA-C22.2 No. 61010-1	JUMO dTRANS CR 02

JUMO GmbH & Co. KG


Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

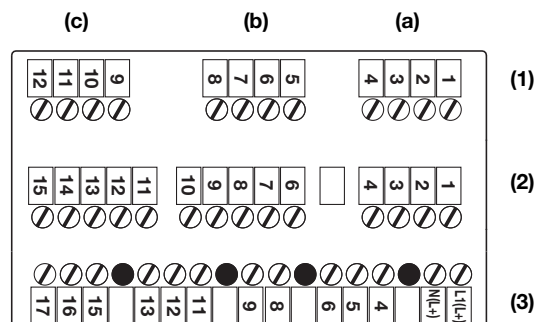**Electrical connection****Mounting information for conductor cross-sections and ferrules**

Ferrule	Conductor cross-section		Minimum ferrule length or stripping
	Minimum	Maximum	
Without ferrule	0.34mm ²	2.5mm ²	10mm (stripping)
Without collar	0.25mm	2.5mm ²	10mm
With collar up to 1.5mm ²	0.25mm ²	1.5mm ²	10mm
Twin, with collar	0.25mm ²	1.5mm ²	12mm

(1)	Row 1	(a)	Option 1	(b)	Option 2	(c)	Option 3
(2)	Row 2	Main board (conductivity / resistance / temperature / standard signal)					
(3)	Row 3	PSU board (power supply / 2x relays)					

Optional board (row 1, slot a, b or c)

Function	Symbol	Terminal for slot (a)	Terminal for slot (b)	Terminal for slot (c)
Analog input				
Temperature sensor in a two-wire circuit Pt100 or Pt1000		2 4	6 8	10 12
Temperature sensor in a three-wire circuit Pt100 or Pt1000		2 3 4	6 7 8	10 11 12
Resistance transmitter		2 3 4	6 7 8	10 11 12
Electrical current		3 4	7 8	11 12
Voltage 0(2) - 10 V		1 2	5 6	9 10
Voltage 0 - 1 V		2 3	6 7	10 11
Continuous output				
Current or voltage		2 3	6 7	10 11
Modbus interface				
RS422		1 2 3 4	5 6 7 8	9 10 11 12
RS485		3 4	7 8	11 12

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us



Function	Symbol	Terminal for slot (a)	Terminal for slot (b)	Terminal for slot (c)
Profibus interface				
	VP(+5V) RxD/TxD-P(B) RxD/TxD-N(A) DGND	1 2 3 4	5 6 7 8	9 10 11 12
Datalogger interface				
RS485	RxD/TxD+ RxD/TxD-	2 3	6 7	10 11
Relay (1x changeover)				
		K3 1 2 3	K4 5 6 7	K5 9 10 11
Relay (2x NO, common pin)				
		K3 1 2 K6 3		K5 9 10 K8 11
Triac (1 A)				
		K3 2 3	K4 6 7	K5 10 11
Foto-MOS relay (0.2 A)				
		K3 1 2	K4 5 6	K5 9 10
		K6 3 4	K7 7 8	K8 11 12

Main board (row 2)

Function	Symbol	Terminal
Standard signal input for electrical current 0(4) - 20 mA		3 4
Standard signal input for voltage 0(2) - 10 V or 10 - 0(2) V		1 4
Temperature sensor in a two-wire circuit Pt100 or Pt1000		2 3 4
Temperature sensor in a three-wire circuit Pt100 or Pt1000		2 3 4
Resistance transmitter		4 3 2
Function	Symbol	Terminal

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us



Conductivity cell		
Conductivity cell (2-electrode system) Terminals 6+7 and 8+9 can be bridged on the instrument; 2-wire cable routing up to the head of the conductivity cell. For concentric cells, terminal 6 must be connected with the outer electrode.		6 7 8 9
Conductivity cell (2-electrode system) Wiring for highest accuracy; 4-wire cable routing to the head of the conductivity cell. For concentric cells, terminal 6 must be connected with the outer electrode.		6 7 8 9
Conductivity cell (4-electrode system) 6 - Outer electrode 1 7 - Inner electrode 1 8 - Inner electrode 2 9 - Outer electrode 2		6 7 8 9
Shield connection		
Conductivity cell		10 GND
Binary inputs		
Binary input 1		12+ 14
Binary input 2		13+ 14

PSU board (row 3)

Function	Symbol	Terminal
Power supply for JUMO dTRANS 02		
Power supply: AC 110 - 240 V Power supply: AC/DC 20 - 30 V		1 L1 (L+) 2 N (L-)
n.c.		4 5 6
Supply voltage for external 2-wire transmitter		
24 V DC (-15 / +20%)		8 L + 9 L -
Relay 1		
Switching output K1 (floating)		11 12 13
Relay 2		
Switching output K2 (floating)		15 16 17

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.


JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us



Dimensions

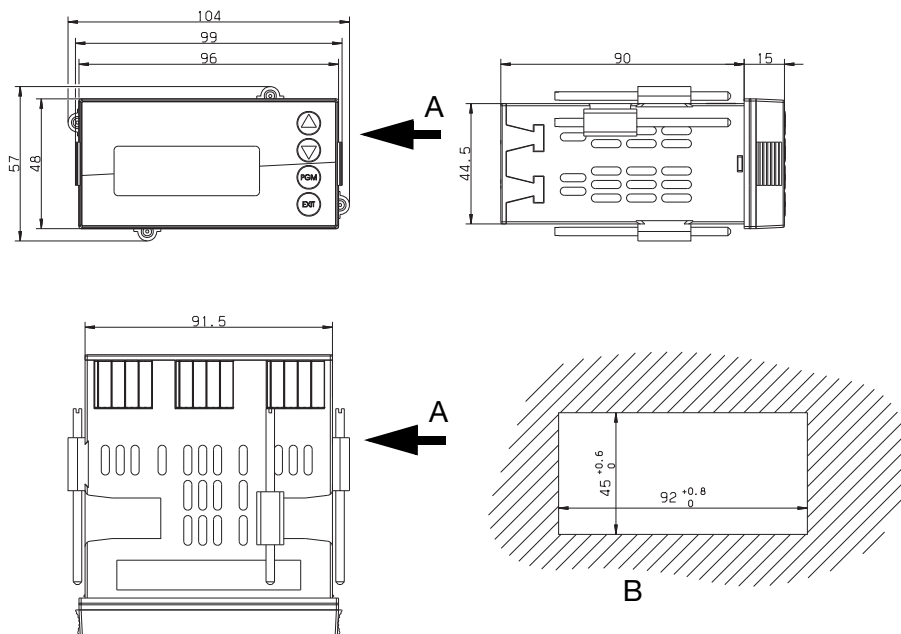

A PC interface socket


B Panel cutout to DIN IEC 61554: 2002-08

Close mounting

Minimum spacing of panel cutouts	Horizontal	Vertical
Without setup connector:	30mm	11 mm
With setup connector (see arrow):	65mm	11 mm

Application examples

Conductivity measurement (temperature compensated)

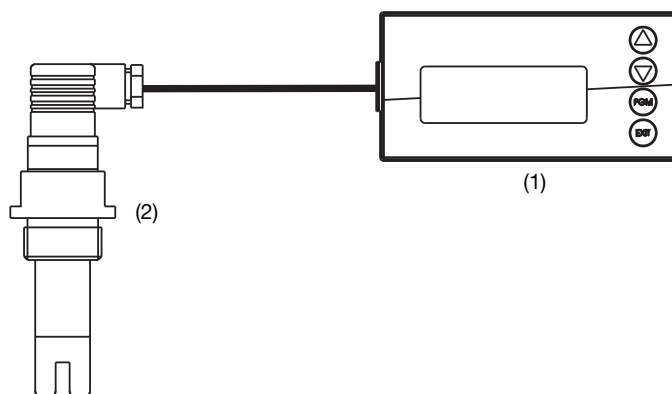

(1) JUMO dTRANS CR 02

(2) Conductivity cell

JUMO GmbH & Co. KG


Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.


JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

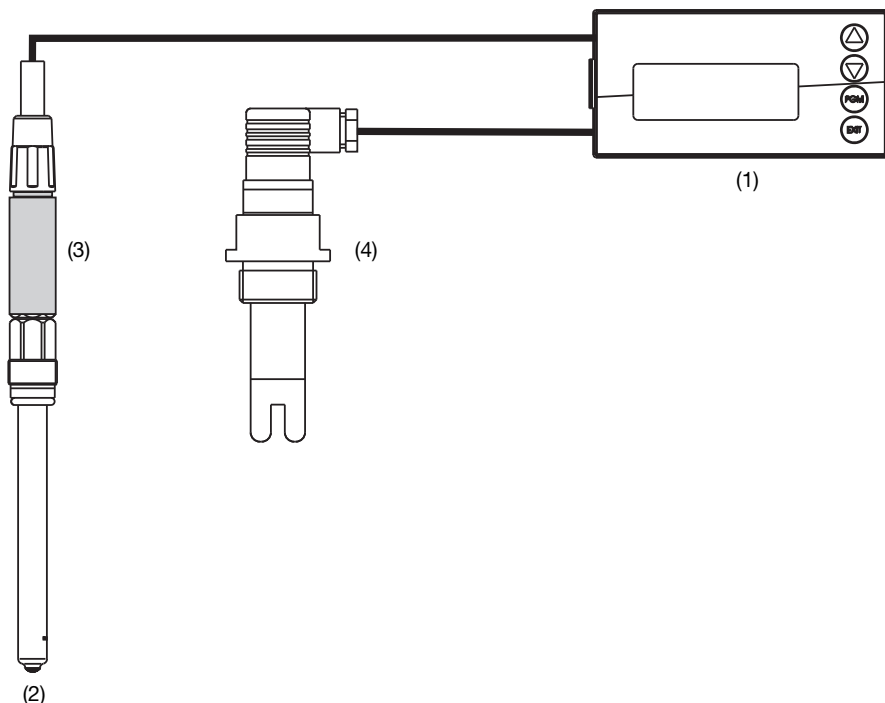**Redox measurement and conductivity measurement (temperature compensated)**

- (1) JUMO dTRANS CR 02
- (2) Redox combination electrode
- (3) 2-wire transmitter, type 202701
- (4) Conductivity cell

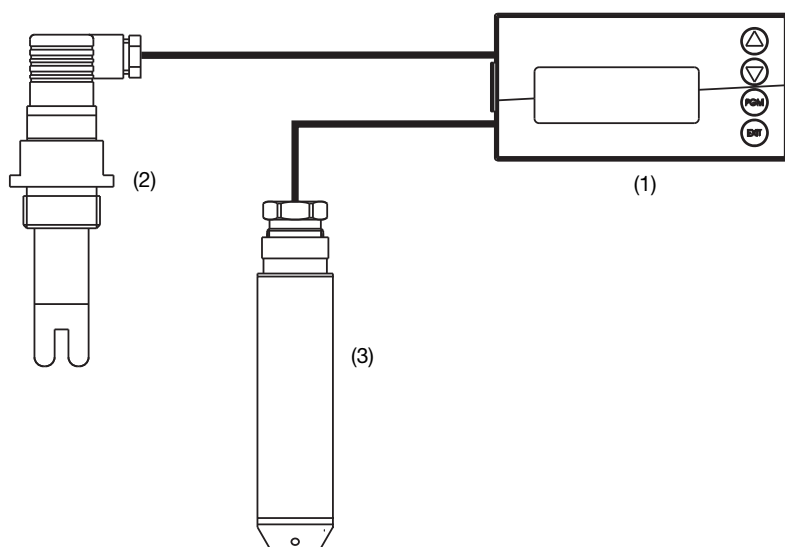Conductivity measurement (temperature compensated) and level or liquid level measurement¹

- (1) JUMO dTRANS CR 02
- (2) Conductivity cell
- (3) Level measurement probe
Type JUMO dTRANS p90 or type
404390 or type 404391

JUMO GmbH & Co. KG


Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

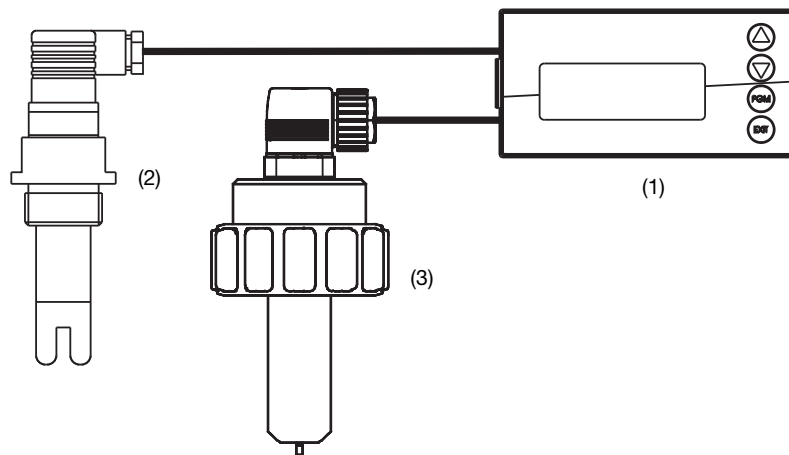**Conductivity measurement and flow-rate measurement**

- (1) JUMO dTRANS CR 02
- (2) Conductivity cell
- (3) MID flow rate transmitter,
type 406010

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

**Order details: JUMO dTRANS CR 02****(1) Basic type**

202552 JUMO dTRANS CR 02
Transmitter/controller

(2) Basic type extension

- 01 In the panel enclosure
- 05 In the surface-mounted enclosure

(3) Version

- 8 Standard with factory setting
- 9 Programming to customer specification

(4) Operating language¹

- 01 German
- 02 English
- 03 French
- 04 Dutch
- 05 Russian
- 06 Italian
- 07 Hungarian
- 08 Czech
- 09 Swedish
- 10 Polish
- 13 Portuguese
- 14 Spanish
- 16 Rumanian

(5) Optional slot 1

- 0 Not used
- 1 Analog input 2 (universal)
- 2 Relay (1x changeover)
- 3 Relay (2x normally open)
- 4 Analog output
- 5 Two MosFET semiconductor switch
- 6 Semiconductor relay 1 A
- 8 Supply voltage output 12 V DC (e.g. for inductive proximity switch)

(6) Optional slot 2

- 0 Not used
- 1 Analog input 2 (universal)
- 2 Relay (1x changeover)
- 4 Analog output
- 5 Two MosFET semiconductor switch
- 6 Semiconductor relay 1 A
- 8 Supply voltage output 12 V DC (e.g. for inductive proximity switch)

¹ All languages are available on the instrument and can be changed by the customer at any time. **Factory** default setting to a language (other than "German") is available for a charge.

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us

**(7) Optional slot 3**

- 00 Not used
- 01 Analog input 2 (universal)
- 02 Relay (1x changeover)
- 03 Relay (2x normally open)
- 04 Analog output
- 05 Two MosFET semiconductor switch
- 06 Semiconductor relay 1 A
- 08 Supply voltage output 12 V DC (e.g. for inductive proximity switch)
- 10 Interface - RS422/485
- 11 Datalogger with interface RS485²
- 12 Profibus DP interface

(8) Power supply

- 23 110 - 230 V AC, +10% / -15%, 48 - 63 Hz
- 25 20 - 30 V AC/DC, 48 - 63 Hz

(9) Extra codes³

- 000 None

² The only way to read data is with the PC setup software!

³ List extra codes in sequence, separated by commas.

Order code (1) (2) (3) (4) (5) (6) (7) (8) (9) ...³
 Sample order 202552 / 01 - 8 - 01 - 2 - 2 - 04 - 23 / 000

Stock versions

(delivery 3 working days after receipt of order)

Order code	Sales No.	
202552/01-8-01-4-0-00-23/000	20/00550843	

Accessories

(delivery 10 working days after receipt of order)

Item		Sales No.	
Holder for C rail;	PG 709710	70/00375749	
Dummy cover 96mm x 48mm;	PG 709710	70/00069680	
Pipe mounting set;	PG 209791	20/00398162	
Weather protection roof complete for basic type extension 05;	PG 209791	20/00401174	
PC setup software	PG 202599	20/00560380	
PC interface cable including USB/TTL converter and two adapters (USB connecting cable)	PG 709720	70/00456352	

JUMO GmbH & Co. KG

Delivery address: Mackenrodtstraße 14,
36039 Fulda, Germany
Postal address: 36035 Fulda, Germany
Phone: +49 661 6003-0
Fax: +49 661 6003-607
E-mail: mail@jumo.net
Internet: www.jumo.net

JUMO Instrument Co. Ltd.

JUMO House
Temple Bank, Riverway
Harlow - Essex CM20 2DY, UK
Phone: +44 1279 63 55 33
Fax: +44 1279 63 52 62
E-mail: sales@jumo.co.uk
Internet: www.jumo.co.uk

JUMO Process Control, Inc.

8 Technology Boulevard
Canastota, NY 13032, USA
Phone: 315-697-JUMO
1-800-554-JUMO
Fax: 315-697-5867
E-mail: info@jumo.us
Internet: www.jumo.us



Optional board	Code	Sales No.	
Analog input (universal)	1	70/00442785	
Relay (1 x changeover)	2	70/00442786	
Relay (2 x NO)	3	70/00442787	
Analog output	4	70/00442788	
Two MosFET semiconductor switch	5	20/00566677	
Semiconductor relay 1 A	6	70/00442790	
Supply voltage output +/- 5 V DC (e.g. for ISFET)	7	20/00566681	
Supply voltage output 12 V DC (e.g. for inductive proximity switch)	8	20/00566682	
Interface - RS422/485	10	70/00442782	
Datalogger with RS485 interface	11	20/00566678	
Profibus-DP interface	12	20/00566679	